

Micro Control Systems

APPLICATION NOTE

APP-061


Hanbell Jumper Bar Installation

Revision History

Date	Author	Description
04-27-15	DEW	Revised photos, etc.



Photo shows extra nuts installed under jumper bar for clearance of power bolt Insulation.

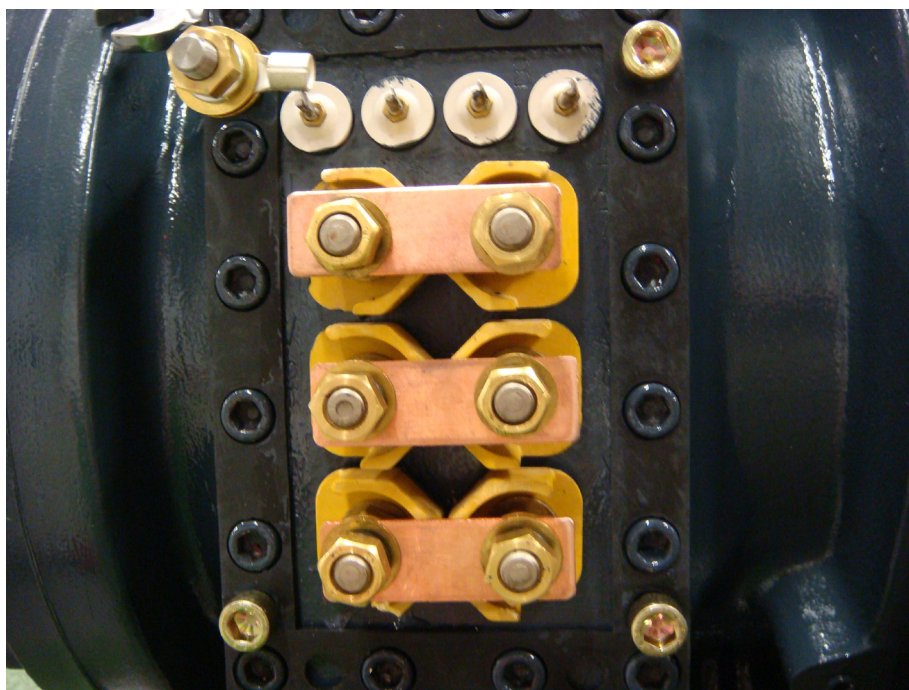

Connect line voltage directly on Terminal post.