

MCS Total Solutions for all your HVAC/R Control Needs

#### MCS-CENTRIFUGAL-12 Industrial Control Panel

**UL 508A** 

CMICRO CONTROL SYSTEMS

.



This brochure describes a standard upgrade package for the 19X Chiller.

Each control upgrade installation is unique. It may be necessary to add additional options to the standard upgrade as described in this brochure.

Fill out the questionnaire in the back of this brochure and forward to your sales representative for an estimate.



Revision - 2024-08-27 Subject to change without prior notice



19XR Chiller Upgraded to MCS-CONTROLS

#### MCS Centrifugal-12 - NEMA rating - Type 1

Dimensions - 27"w x 39.75"h x 8.0"d

Certification - UL508A

#### MCS-MAGNUM-N-12

#### **Controller Specification**

Microprocessor	′D)
Analog Outputs (AO) 4 outputs 0-10vdc	
Printed Circuit Board Six layer with separate po and ground planes	wer
Input Power (Standard) 12vdc	
MCS-I/O Comm Port 1 @ 38,400 baud	
RS-485 Comm Port 1 @ 19,200 baud	
Ethernet 10/100 Mbps Ethernet	
Real Time Clock Battery backup	
Power Detection Automatic power fail reset	

#### **Touch Screen 15.4**

Dimensions	12.11"W x 17"L X 3.228"H
LCD Screen	15.4" (16:10 Diagonal),
	16.2 Million Colors,
	1280x800 Resolution

The MCS-CENTRIFUGAL-12 comes standard equipped with an MCS-MAGNUM-N -12 controller board, 15.4" Touch Screen, three 16 amp, one 20 amp and one 5 amp circuit breakers. There is also an electrical outlet for laptop plug-in power at the panel.

The Enclosure has the following expansion boards installed:

One (1) MCS-SI-Base, One (1) MCS-SI-BASE with MCS-SI-EXT, and



Micro


ONE (1) MCS-RO-Base with MCS-RO-EXT. With the expansion boards you have a total of:

> 60 Sensor Inputs 30 Relay Outputs 16 Analog Outputs

Standard configuration includes: Isolation relays, BMS Network connectivity, (Field selectable hardware or network BMS), and BMS terminal block for chiller relay.

The following warning lights and switches are included in the standard enclosure; Alarm, Warning, Emergency SW, Hand/Off/ Auto Switch.

This panel is intended for use in an environment protected from the weather.

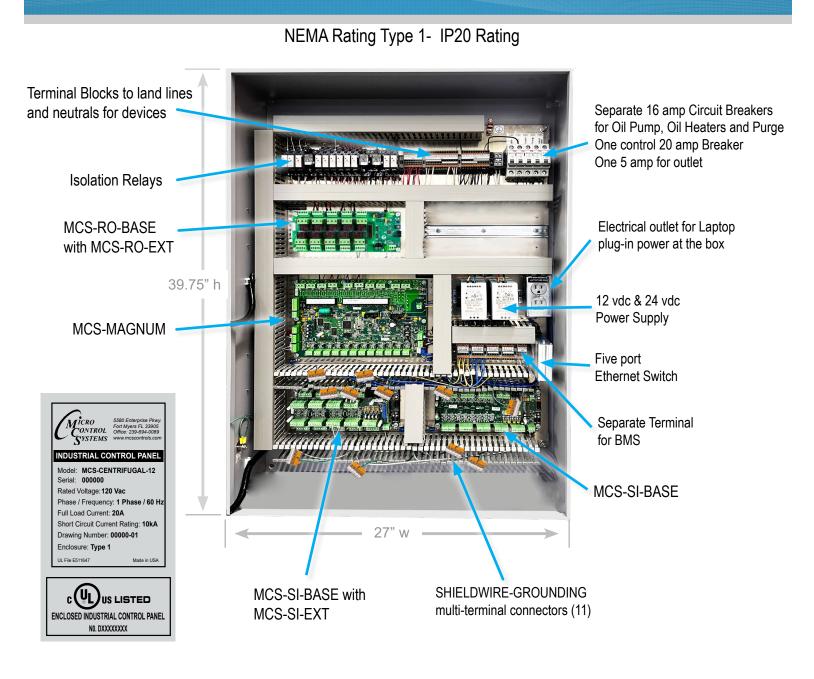

#### **UL 508A Certified Industrial Control Panel**



Benefits of selecting an Industrial Control Panel that carries the UL 508A certification include:

- UL 508A certification provides the inspection authority and your customer evidence that the control panel complies with
  nationally recognized safety standards. These standards ensure public safety and provide assurances that the electrical
  control panel is compliant with national and local electrical codes.
- For a control panel to carry the UL 508A Listing Mark, the panel must contain only UL recognized and listed components. The UL Mark on a component means that UL has evaluated and tested samples of this component and has concluded that they meet the UL requirements. This protects the quality and integrity of the enclosure and provides guarantee of safe performance.

### MCS-MAGNUM-N-12



The **MCS-MAGNUM-N-12** is a durable microprocessor based controller designed for the hostile environments in the HVAC/R industry. It is designed to be the primary manager of the package it is controlling.

The Magnum provides flexibility with set points and control options that can be selected prior to commissioning a system or when the unit is live and functioning. The TouchScreen and MCS-CONNECT provide a clear and simple language that informs the user as to the status of the controller.

### **15.4 TOUCHSCREEN**

The **MCS-TOUCH-15.4** capacitive touchscreen interface designed to simplify user access with the MCS-Magnum and MicroMag utilizing MCS-Connect to provide both graphics and service mode access to technicians. Input method: Finger, glove, stylus.

Highly accurate and does not require calibration - easy to clean glass surface. Works outdoors, bright screen, water resistant, Exceptional Optics - 1280x800 resolution, sharp and vibrant images.

MCS-TOUCH-15.4 comes preloaded with the MCS-CONNECT program that allows you to view the 'unit's status', 'extended history', 'alerts', 'alarms', setpoints, and more, all in a user-friendly graphic format.



- Freescale i.MX6 Dual Core 800mhz Motherboard
- ARM 9 32-bit RISC ARM processor
- 1Gb of 512mhz DDR3 RAM memory
- 4Gb of eMMC Flash memory
- 10m/100m/1G Ethernet

- 1 Micro-SD Slots
- 1 USB On-The-Go
- 2 USB Host 2.0
- Real Time Clock w/ Battery
- 3 RS485 communication ports

### **Graphics For Touchscreens**

With the new Graphical Interface and MCS-CONNECT, you now have a better view of your controller's many functions as shown on the screens.

The basic graphics package is pre-installed and can be customized by OEMs with the MCS Graphic Builder or custom build by MCS for your controllers. See below some customized screens.

#### Standard screens include:


- System Overview Screen
- Compressor Overview Screen
- Evaporator/Condenser Overview Screen
- Documents


Additional screens can be added depending on the custom configuration of your system.


#### Documents, Spec Sheets, Drawings, etc.

Stored in the Touchscreen's flash memory you will find pdf's and documents pertaining to the building of your unit. Each unit's configuration is different, so the 'SITE DOCUMENTS' file will pertain to that unit only and stored at the site.

- 1. DRAWINGS (PDF'S) of the components used in this unit
- 2. MANUALS (if installed in your unit)
  - a. Getting Started Manual
  - b. Keypad Manual
  - c. Touchscreen Manual
  - d. MCS-CONNECT Manual
  - e. EXV Manual
  - f. BMS-GATEWAY Startup Guide

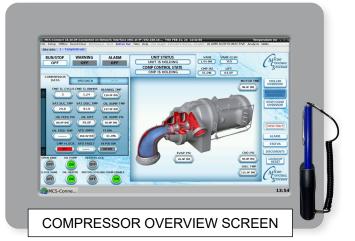

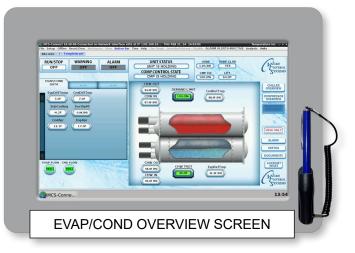

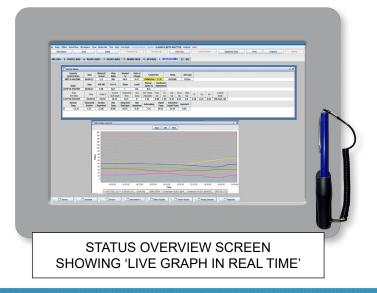


### MCS-SI-BASE

The **MCS-SI-BASE** provides a flexible and cost effective way to allow sensor input and analog output expansion for the **MCS MAGNUM**. Each MCS-SI-BASE has a standalone microprocessor which communicates with the MCS MAGNUM over the MCS-I/O port at 38,400 baud. All data is check summed with auto error correction. Because communication



is over a RS-485 long distance two-wire differential network transmission system, the MCS-SI-BASE may be located up to 5,000 feet away.

Each MCS-SI-BASE board can be powered by a 12VDC regulated power supply and has a automatic power fail reset system.



MCS-SI-EXT mounted to MCS-SI-BASE



The **MCS-SI-EXT** provides a flexible and cost effective way to allow sensor input and analog output expansion for the **MCS MAGNUM**.

Each MCS-SI-EXT can be paired with a MCS-SI-BASE to double the number of inputs and outputs. Each


MCS-SI-EXT board is powered by the MCS-SI-BASE board once it is stacked on top.

## MCS-RO-BASE

The **MCS-RO-BASE** provides a flexible and cost effective way to allow relay output expansion for the **MCS-MAGNUM**. Each MCS-RO-BASE has a stand-alone microprocessor which communicates with a Magnum/Micromag over the MCS-I/O port at 38,400 baud. All data is check summed with auto error correction. Because the communication is over a RS-485 long distance two-wire differential network transmission system, the MCS-RO-BASE may be located up to 5,000 feet away.



The MCS-RO-BASE board is powered by a 12VDC regulated power supply.



MCS-RO-EXT

The **MCS-RO-EXT** provides a flexible and cost effective way to allow relay output expansion for the **MCS MAGNUM**.

Each MCS-RO-EXT can be paired with a MCS-RO-BASE to double the number of outputs. Each MCS-RO-EXT board is powered by the MCS-RO-BASE board once it is stacked on top.

MCS-RO-EXT mounted to MCS-RO-BASE

### MCS-T-100 Temp Sensor



An extremely fast acting temperature sensor built for demanding environments. It is ideal for high moisture locations with continuous freeze and thaw cycles. The sensor is potted with a thermally conductive RTV Cure Silicon Adhesive to guarantee durability and response. Its high accuracy allows for interchangeability in the field. The large resistance range allows the use of over 1000' of cable with no noticeable effect. The MCS-T100 sensor has the ability to move from 32°F to 212°F in approximately 10 to 15 seconds.

#### MCS-Wells/Tubes

The MCS-WELL was designed to be used with the MCS-T100 temperature sensor, although it has other applications. It is used in the 19XR series chillers in the chilled water and condenser water lines. It comes pre-filled with heat conductive compound to aid in temperature to the sensor.





The **MCS-TUBE** can be epoxied to a discharge or suction line on the 19XR series chillers in order to obtain temperature readings without the use of a well. It was designed to be used with the MCS-T100 temperature sensor and comes pre-filled with heat conductive compound to aid in transferring temperature to the sensor.



ACS-USB-RS485

The **MCS-USB-RS485** is a USB to RS485 cable that provides a fast simple way to connect a **MCS-MAGNUM** or **MicroMAG** to a Laptop or PC.

The MCS-USB-RS485 cable contains a small internal electronic circuit board, which converts USB to RS485 with LED indicators for transmit (TX=Red) and receive (RX=Green).

When the MCS-USB-RS485 cable is plugged into a laptop or PC, Windows will install a device driver that allows the cable to be used as a standard Window communication port.

### MCS-CARRIER 5K-ADAPTER

The 19X series chillers comes equipped with embedded 5K thermistors in the motor. There are two (2) thermistors factory installed in each compressor. There are three (3) terminals for the thermistors. (S1, S2 & C) Motor temperature is measured by leads connected to one of the S terminals and the C terminal.

The thermistor's are not field serviceable. If both motor thermistors fail the compressor needs to be replaced.

In order to monitor the motor on the 19X series chillers a cable is installed on the C and S1 terminals of the Carrier's thermistor and then wired along with the MCS-CARRIER 5K-ADAPTER to a sensor input on the MCS-MAGNUM or MCS-SI-BASE board. This allows the MAGNUM to monitor the temperature of the 19X series motors for proper operation.

A wiring diagram and instructions are included with the MCS-CARRIER 5K-ADAPTER.





### MCS-CT300

The **MCS-CT300** current sensor monitors current flowing to electrical equipment. The magnitude of the current is converted to a linear 0 to 5vdc output signal which can be read as a standard analog input signal. The signal is used by MCS micro controllers for the following:

- 1. For slide valve control on screw machines
- 2. For high amp motor overload protection
- 3. For verification of device on / off

### MCS-PRESSURE TRANSDUCERS



The **MCS Pressure Transducers** are one of the most economical and durable options on the market for dealing with high-pressure industrial applications.

In addition to being CE and UL approved, MCS transducers are capable of surviving high vibration. They include a cavity built out of solid 17-4 PH stainless steel ¼" SAE Female Flare fitting & Schrader valve; 7/16-20 UNF pipe thread which creates a leak-proof, all metal sealed system that makes the transducers ideal for use with rugged HVAC environments.

### MCS-VOLTAGE-3PH

The **MCS-VOLTAGE-3PH** measures AC voltage between 200-600 AC. It is designed to monitor the voltage of each phase of the main input power to the unit.

The MCS-VOLTAGE-3PH sensor provides three separate DC voltage outputs that correspond to the AC voltage it is measuring.

This sensor allows the **MCS-Magnum** to safely protect the motors on the unit from under voltage, over voltage and voltage imbalance conditions. It also can be used to calculate unit KW (requires amp and power factor sensors).



## 19XL / XR Typical Options



The **MCS-BMS-GATEWAY** is a microprocessor based communication device that provides translation from BACnet IP to LonTalk, BACnet MSTP, or Johnson N2. Information that can be transmitted includes the status of control points, alarm information, digital inputs, analog inputs or setpoints.



#### **Relay Outputs**

#	Output Name	Туре	Description				
M-1	CompM	Standard	Compressor Start Main				
M-2	CompD	Standard	Compressor Start Delta				
M-3	OpenVane	Standard	Vane open: relay output used to open the compressor guide vane.				
M-4	CloseVane	Standard	Vane closed: relay output used to close the compressor guide vane.				
M-5	OilPump	Standard	Oil pump: Turn ON or OFF				
M-6	OilHeater	Standard	Oil heater: Turn ON or OFF				
M-7	HtrLock	User Logic	Heater Lock (Lock is ON when Compressor is ON)				
M-8	Spare	X	Not Used - Reserved for Expansion				
M-9	Spare	X	Not Used - Reserved for Expansion				
M-10	Spare	х	Not Used - Reserved for Expansion				
1-1	Spare	X	Not Used - Reserved for Expansion				
1-2	Warning	Standard	Warning Light: unit is in a safety condition prior to a safety shutdown.				
1-3	Alarm	Standard	Alarm Light: unit is in a safety shutdown				
1-4	RunStatus	User Logic	Hardwired or BMS point to notify BMS that the unit is running				
1-5	Spare	X	Not Used - Reserved for Expansion				
1-6	Spare	x	Not Used - Reserved for Expansion				
1-7	Spare	X	Not Used - Reserved for Expansion				
1-8	ChwPump	Standard	Chilled Water Pump: Turn ON or OFF				
1-9	CondPump	Standard	Condenser Pump: Turn ON or OFF				
1-10	Spare	х	Not Used - Reserved for Expansion				
2-1	Spare	X	Not Used - Reserved for Expansion				
2-2	Spare	х	Not Used - Reserved for Expansion				
2-3	MtrCooling	User Logic	Motor Cooling: Turn ON or OFF				
2-4	Spare	х	Not Used - Reserved for Expansion				
2-5	Spare	х	Not Used - Reserved for Expansion				
2-6	Spare	X	Not Used - Reserved for Expansion				
2-7	Spare	х	Not Used - Reserved for Expansion				
2-8	Spare	x	Not Used - Reserved for Expansion				

#### **Relay Outputs (contined)**

#	Output Name	Туре	Description			
2-9	Spare	х	Not Used - Reserved for Expansion			
2-10	Spare	х	Not Used - Reserved for Expansion			
3-1	Spare	x	Not Used - Reserved for Expansion			
3-2	Spare	х	Not Used - Reserved for Expansion			
3-3	HwBmsR/S	User Logic	Hardwired BMS Run/Stop			
3-4	NtBmsR/S	User Logic	Virtual Network Point for BMS Run/Stop			
3-5	Spare	х	Not Used - Reserved for Expansion			
3-6	Spare	х	Not Used - Reserved for Expansion			
3-7	Spare	х	Not Used - Reserved for Expansion			
3-8	DisHWRst	User Logic	Disallow Hardwire Reset			
3-9	DisNetRst	User Logic	DisNetRst			
3-10	HtrlLock	User Logic	Heater Lock (Lock is ON when Compressor is ON)			

#### **Sensor Inputs**

#	Input Name	Туре	Description	
M-1	ChilWtrIn	MCST100	Chilled Water In Temperature	
M-2	ChilWtrOut	MCST100	Chilled Water Leaving Temperature	
M-3	Suct Psi	MCS200	Suction Pressure	
M-4	DiscPsi	MCS-500	Discharge Pressure	
M-5	OilFeedPsi	MCS-500	Oil Supply Pressure	
M-6	OilSumpPsi	CARR-5K	Oil Sump Pressure	
M-7	SuctTmp	MCST100	Suction Temperature	
M-8	DiscTmp	MCST100	Discharge Temperature	
M-9	OilFeedTmp	MCST100	Oil Supply Temperature	
M-10	Spare	х	Not Used - Reserved for Expansion	
M-11	OilSumpTmp	CARR-5K	Oil Sump Temperature	
M-12	Spare	х	Not Used - Reserved for Expansion	
M-13	VaneClosed	Digital	Vane Closed Switch: ON or OFF	
M-14	PhaseLoss	Digiital	Phase Loss: Phase Imbalance	

#	Input Name	Туре	Description				
M-15	Run/Stop	Digital	Run/Stop Hand Switch				
M-16	EmgStop	Digital	Emergency Stop Switch				
1-1	CndRefTmp	MCST100	Condenser Refrigerant Temperature				
1-2	EvapRefTmp	MCST100	Evaporator Refrigerant Temperature				
1-3	CmpAmps A	CT-1500	Reads Amp Draw on Leg 1				
1-4	CmpAmps B	CT-1500	Reads Amp Draw on Leg 2				
1-5	CmpAmps C	CT-1500	Reads Amp Draw on Leg 3				
1-6	Volts A	User Defined	Volts Phase A				
1-7	Volts B	User Defined	Volts Phase B				
1-8	Volts C	User Defined	Volts Phase C				
1-9	HiPsiSW	Digital	Mechanical Hi Pressure Safety				
1-10	MotorTmp	CARR-5K	Motor Temperature				
1-11	Spare	х	Not Used - Reserved for Expansion				
1-12	Spare	х	Not Used - Reserved for Expansion				
1-13	BearingTmp	CARR-5K	Bearing Temperature				
1-14	Spare	х	Not Used - Reserved for Expansion				
1-15	TransOK	Digital	Transition Starter OK				
1-16	Spare	x	Not Used - Reserved for Expansion				
2-1	Spare	x	Not Used - Reserved for Expansion				
2-2	Spare	х	Not Used - Reserved for Expansion				
2-3	Spare	х	Not Used - Reserved for Expansion				
2-4	Spare	х	Not Used - Reserved for Expansion				
2-5	Spare	х	Not Used - Reserved for Expansion				
2-6	Spare	х	Not Used - Reserved for Expansion				
2-7	ChwFlowSW	Digital	Proof for Chilled Water Flow				
2-8	CdwFlowSW	Digital	Proof for Condenser Water Flow				
2-9	OilDiffSW	Digital	Oil pressure differential				
2-10	CndWtrIn	MCST100	Condenser Water Incoming Temperature				
2-11	CndWtrOut	MCST100	Condenser Water Leaving Temperature				

#	Input Name	Туре	Type Description		
2-12	Spare	х	Not Used - Reserved for Expansion		
2-13	HwBmsDmd	DEMAND%	Hardwired Point for Demand %		
2-14	HwBmsChwr	TRGTRST	Hardwired BMS Chilled Water Reset: Reset Target Temperature		
2-15	Spare	х	Not Used - Reserved for Expansion		
2-16	Spare	Х	Not Used - Reserved for Expansion		
3-1	Spare	x	Not Used - Reserved for Expansion		
3-2	Spare	х	Not Used - Reserved for Expansion		
3-3	Spare	х	Not Used - Reserved for Expansion		
3-4	Spare	х	Not Used - Reserved for Expansion		
3-5	Spare	х	Not Used - Reserved for Expansion		
3-6	Spare	х	Not Used - Reserved for Expansion		
3-7	Spare	х	Not Used - Reserved for Expansion		
3-8	Spare	х	Not Used - Reserved for Expansion		
3-9	Spare	х	Not Used - Reserved for Expansion		
3-10	Spare	х	Not Used - Reserved for Expansion		
3-11	Spare	х	Not Used - Reserved for Expansion		
3-12	UnitInL/O	User Logic	Tests for Unit in Lock Out		
3-13	CtlRun/Stop	User Logic	Control Run/Stop		
3-14	Spare	х	Not Used - Reserved for Expansion		
3-15	Spare	х	Not Used - Reserved for Expansion		
3-16	Spare	х	Not Used - Reserved for Expansion		
4-1	Spare	x	Not Used - Reserved for Expansion		
4-2	Spare	х	Not Used - Reserved for Expansion		
4-3	ChwGPM	User Logic	Chilled Water Gallons per Minute. Fixed value or true hardwired input.		
4-4	Spare	x	Not Used - Reserved for Expansion		
4-5	 NetBmsRun	BMS-SI	Virtual Network Point for Run/Stop		
4-6	NetBmsDmd	BMS-SI	Virtual Network Point for Demand %		
4-7	NetBmsCwr	BMS-SI	Virtual Network Point for Chilled Water Reset: Reset Target Temp		
4-8	Fla%	User Logic	Full Load Amp %		

#	Input Name	Туре	Description		
4-9	Lift	User Logic	Lift Calculation		
4-10	ChwAppr	User Logic	Condenser Water Approach: Difference between saturated discharge tem- perature minus the condenser leaving water temperature		
4-11	ChwDiffTmp	User Logic	Chilled Water Temperature Differential: Difference between entering/leav- ing temperature		
4-12	CdwAppr	User Logic	Condenser Water Approach: Difference between saturated discharge tem- perature minus the condenser leaving water temperature		
4-13	CdwDiffTmp	User Logic	Chilled Water Temperature Differential: Difference between entering/leav- ing temperature		
4-14	Spare	х	Not Used - Reserved for Expansion		
4-15	Subcooling	User Logic	Subcooling Calculation		
4-16	Spare	x	Not Used - Reserved for Expansion		
5-1	Spare	x	Not Used - Reserved for Expansion		
5-2	Spare	х	Not Used - Reserved for Expansion		
5-3	Spare	х	Not Used - Reserved for Expansion		
5-4	Unit Tons	TONS	Measures Unit Tons		
5-5	Unit KW	КW	Measures Unit KW		
5-6	Kw/Tons	User Logic	KW / Ton Calculation		
5-7	PwrFactor	User Logic	Power Factor Calculation		
5-8	Spare	x	Not Used - Reserved for Expansion		
5-9	OilPsiSwOK	User Logic	Proof of Oil Pressure Switch OK		
5-10	Spare	x	Not Used - Reserved for Expansion		
5-11	Spare	x	Not Used - Reserved for Expansion		
5-12	Ctl Flow	User Logic	Control Flow - Tests both Condenser and Chilled Water Flow		
5-13	Spare	х	Not Used - Reserved for Expansion		
5-14	Spare	х	Not Used - Reserved for Expansion		
5-15	Spare	х	Not Used - Reserved for Expansion		
5-16	Spare	x	Not Used - Reserved for Expansion		
6-1	Spare	Х	Not Used - Reserved for Expansion		
6-2	Spare	x	Not Used - Reserved for Expansion		

6-3	Spare	х	Not Used - Reserved for Expansion		
6-4	Spare	х	Not Used - Reserved for Expansion		
6-5	Spare	х	Not Used - Reserved for Expansion		
6-6	HwBmsDMD	User Logic	Hardwired Point for Demand %		
6-7	HwBmsRset	User Logic	Hardwired Point for Target Reset		
6-8	NtBmsDMD	User Logic	Virtual Network Point for Demand %		
6-9	NtBmsRset	User Logic	Virtual Network Point for Target Reset		
6-10	BMS R/S	User Logic	Virtual Network Point for Run/Stop		
6-11	BMS DMD	User Logic	Virtual Network Point for Demand %		
6-12	BMS Reset	User Logic	Virtual Network Point for Target Reset		
6-13	d/aHwRst	User Logic	Disallow Hardwired Reset		
6-14	d/aNetRst	User Logic	Disallow Network Reset		
6-15	Spare	х	Not Used - Reserved for Expansion		
6-16	Allow Unit	User Logic	Run/stop indicator for graphic display		

# **19XR Information**

NOTE: This form has drop down fillable areas. If you are viewing from a brochure,please visit our website for a fillable form that you can email to: sales@mcscontrols.com

Co	mpany:					Phone: _			
Na	me:					Email:			
Mc	bile:			Site:	<u> </u>				
	Model Number		Ser	ial Numb	ber		Refrigerant Used		l Load Compressor
1.	Model of existing Panel:								
2.	What is the Starter Type?			Are we	e monitorii	ng the Transitio	n OK or Starter Fa	ult?	
	a. Does the Compressor have a	a remote starter?	Yes		No				
3.	Is there a Variable Frequency Dri	ve?: What is the \	/FD Make	and Mode	l? Mak	e:	Мс	odel:	
	a. Will the VFD be hardwired to	MCS controls, ov	er MODBU	IS or both	?				
	b. If you are using a VFD other	than a Yaskawa V	FD, do you	u need MC	CS to contro	ol the VFD Enclo	osure Temperature a	and Fans?	Yes No
4.	What protocol will be used for B	uilding Managem	ent comm	unication	?				
5.	For the Vane Actuator, is there a	Digital Switch or	a Potentic	ometer?					
6.	If there is a Potentiometer, what i	is the Actuator M	odel?	Model:					
7.	Will Phase loss need to be monit	ored? Yes	No	How wo	uld you lil	ke the pressure	s to be displayed?	,	
8.	Does the Oil Heater have an optic	on for Heater In L	ock Out?	Yes	No				
9.	What kind of Hot Gas Bypass is	present?							
10.	Is MCS controlling the Chilled Wa	ater Pump(s)?	Yes	No H	ow will the	ey be wired?			
11.	Is MCS controlling the Condense Will the Condenser Water Pum	-	Yes I <b>I a Conde</b>	No <b>nser Isol</b> a	ation Valve	be used?			
12.	Are there Tower Fan(s) Yes	No Is MCS	controllin	g these fa	an(s)? Hov	v many are ther	e, how are they wi	red?	
13.	Does the unit have Motor Cooling	g? Yes		No					
14.	Does the unit have a Shunt Trip?	Yes		No					
15.	What Main Voltage is being supp	lied to the unit?	Voltage:_			_ Is MCS monite	oring Main Voltage?	Yes	No
16.	What is the Control Voltage being	g supplied?	Voltage:_			_			
17.	What is the 'RUN LOAD AMPS' (F	ELA)	СОМ	IP 1:		COMP 2:			
18.	Will the Chilled/Condenser Water	r Flow be measur	ed by Flow	w or Diffe	rential?				
19.	Will Ambient Temperature need t	o be monitored?	Y	Yes	No				
20.	Will MCS be Monitoring the Oil R	eturn Temperatu	re?	Yes	No				

#### COMMENTS (is there any other information we should know?):



5580 Enterprise Pkwy., Fort Myers, FL 33905 Office: 239-694-0089 • Fax: 239-694-0031 www.mcscontrols.com