



***MCS Total  
Solutions for all your  
HVAC/R Control Needs***



**MCS-NITROMAG-CENT  
Industrial Control Panel**



**NEW**

# ***MCS-NITROMAG-Upgrade Brochure 19XL / XR / XRV Series with Optional VFD Control***

Click for Brochure Upgrades ►

This brochure describes a standard upgrade package for the 19X Chiller.

Each control upgrade installation is unique. It may be necessary to add additional options to the standard upgrade as described in this brochure.

Fill out the questionnaire in the back of this brochure and forward to your sales representative for an estimate.



Revision - 2025-08-20  
Subject to change without prior notice

# 19XL / XR Series Control Enclosure Upgrade



## Upgrade Specifications

### **MCS NITROMAG-CENTRIFUGAL Industrial Control Panel**



The **MCS-NITROMAG-CENTRIFUGAL** is a control system containing a Capacitive Touchscreen, MCS-NITROMAG Controller, MCS-IO-BASE, MCS-IO-EXT, MCS-SI-BASE, MCS-SI-EXT and a MCS-RO-BASE. It includes a processor, memory, eMMC Flash, and supporting power circuitry. Control panel includes the following; 20A, 16A and a 5A Single-Pole Circuit Breaker. A 5-port 10/100/1000 Mbps Ethernet Workgroup Switch Industrial rated, Red Alarm Indicator, Yellow Warning Indicator, Emergency Stop Switch with guard and 3 Position Run/Stop Selector Switch.

The Capacitive touchscreen interface designed to simplify user access with the MCS Expansion Boards and utilizing MCS-Connect to provide both graphics and service mode access to technicians. Highly accurate and does not require calibration - easy to clean glass surface. Works outdoors, bright screen, water resistant, Exceptional Optics - 1280x800 resolution, sharp and vibrant images.

The MCS-NITROMAG controller comes with a built-in WiFi interface for Ethernet connectivity, and an onboard WiFi antenna connection mounted on the front of the touchscreen.

## Specifications

Dimensions of control panel ...27"w x 39.75"h x 8.0"d  
Rated Voltage (Standard) .....120VAC or 230VAC  
Phase / Frequency .....1 Phase / 60Hz  
Full Load Current(approx) .....40A at 120VAC or 20A at 240VAC  
Short Circuit Current Rating ..10kA

### **Temp. Range for Control Panel & Touch Screen**

LCD Screen..... 15.4" (16:10 Diagonal)  
16.2 Million Colors  
1280x800 Resolution  
Capacitive Stylus pen  
Touchscreen Surface..... UV Degradation Protection  
Operating Temperature..... -22°F to 176°F (-30°C to +80°C)  
Operating Humidity..... 90 %RH (Non Condensing)  
Storage Temperature..... -22°F to 176°F (-30°C to +80°C)

## Controller

Microprocessor .....Broadcom BCM2711 Quad core  
Cortex (ARMv8) 64-bit SoC @ 1.5Ghz  
Flash Memory .....16 GB EMMC  
RAM .....2 GB DDR3  
MCS-I/O Comm Port. ....1 @ 38,400 baud  
RS-485 Ports.....2 @ go up to 115200 baud rate  
Ethernet.....10 Mbps/100Mbps/1Gbps  
HDMI .....2 HDMI 2.0 ports-Standard and Micro  
WiFi.....2.4 GHz, 5.0GHz 8.02 b/g/n/ac wireless  
USB(2) .....USB type B 2.0 ports 480Mbps signalling  
Protocols.....BACnet IP, BACnet MSTP, Modbus IP,


### **Power Supply - Specification**

**12vdc power supply**.....85vac ~ 264vac  
AC frequency range.....47 ~ 63Hz / 7.5A / 90W  
**24vdc power supply**.....85vac ~ 264vac  
AC frequency range.....47 ~ 63Hz / 4A / 96W

# MCS-NitroMag-Centrifugal

## Industrial Control Panel

NEMA Rating Type 2- IP30Rating

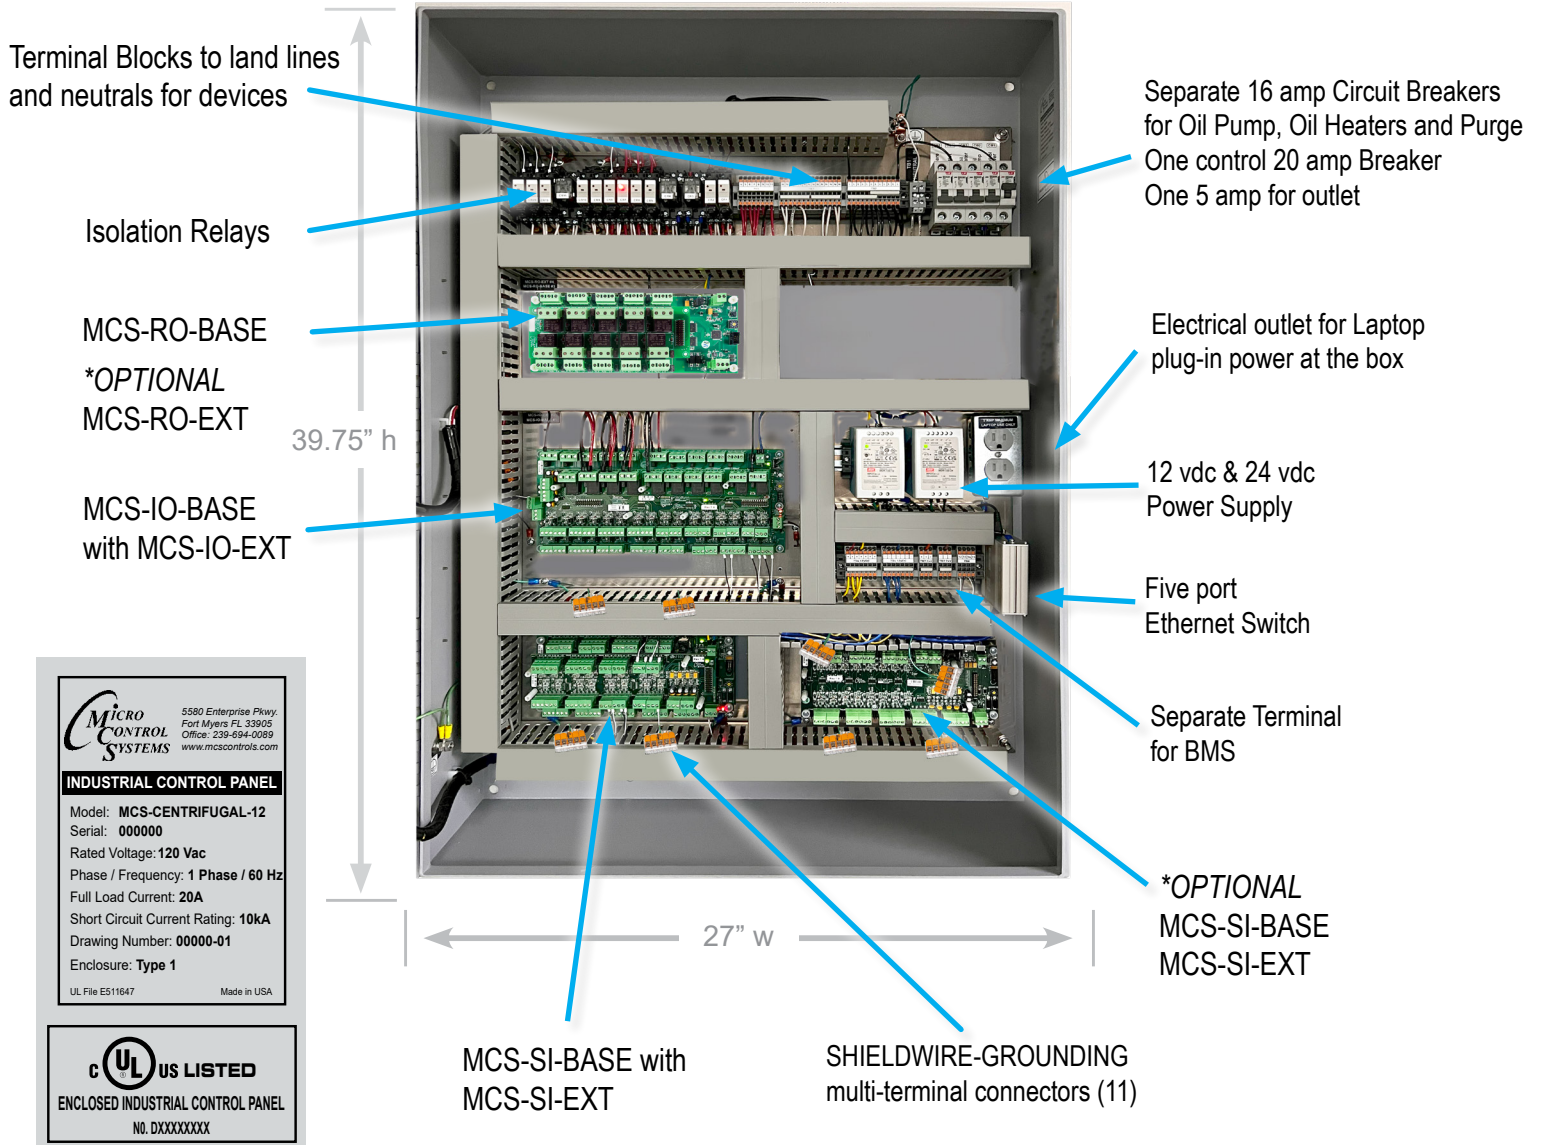

\* Optional MCS Expansion and Extension boards shown

## UL 508A Certified Industrial Control Panel

Benefits of selecting an Industrial Control Panel that carries the UL 508A certification include:

- UL 508A certification provides the inspection authority and your customer evidence that the control panel complies with nationally recognized safety standards. These standards ensure public safety and provide assurances that the electrical control panel is compliant with national and local electrical codes.
- For a control panel to carry the UL 508A Listing Mark, the panel must contain only UL recognized and listed components. The UL Mark on a component means that UL has evaluated and tested samples of this component and has concluded that they meet the UL requirements. This protects the quality and integrity of the enclosure and provides guarantee of safe performance.

# Example Graphics MCS-NitroMag-15.4

## MCS-NitroMag 15.4 Touchscreen

### WiFi Antenna

Built in WiFi - 2.4 GHz, 5.0 GHz.

Graphics preloaded

**Modbus RTU Master  
programmed in Firmware**  
Supports up to 10 Modbus  
devices e.g., VFD's KW Meter,  
Compressors.

**2 HDMI ports**  
(1 Standard & 1 Micro)

The **MCS-NitroMag-15.4** capacitive touchscreen interface designed to simplify user access with the MCS-Magnum, MCS- NitroMag and MicroMag utilizing MCS-Connect to provide both graphics and service mode access to technicians. Input method: Finger, glove, stylus.

Highly accurate and does not require calibration - easy to clean glass surface. Works outdoors, bright screen, water resistant, Exceptional Optics - 1280x800 resolution, sharp and vibrant images.





With the new Graphical Interface and MCS-CONNECT, you now have a better view of your controller's many functions as shown on the screens.

MCS-MCS-NitroMag-15.4 comes preloaded with the MCS-CONNECT program that allows you to view the 'unit's status', 'extended history', 'alerts', 'alarms', setpoints, and more, all in a user-friendly graphic format.

The basic graphics package is pre-installed and can be customized by OEMs with the MCS Graphic Builder or custom built by MCS for your controllers.


### Standard screens include:

- **SYSTEM OVERVIEW, COMPRESSOR OVERVIEW, EVAPORATOR/CONDENSER OVERVIEW, PURGE OVERVIEW**

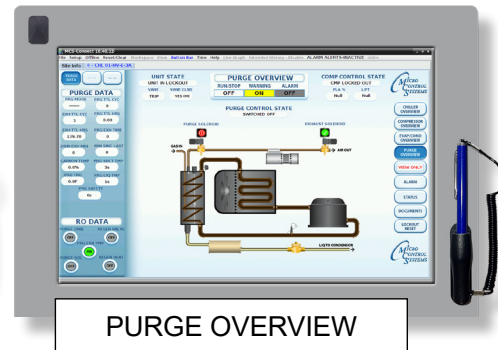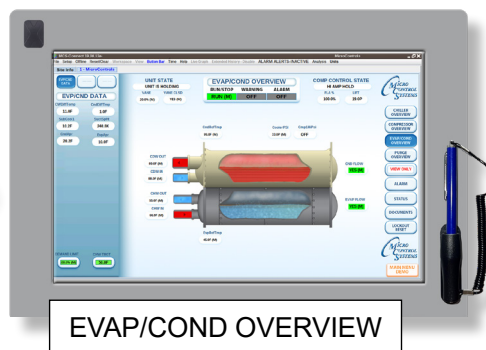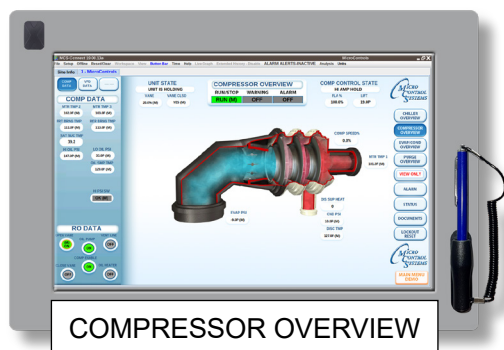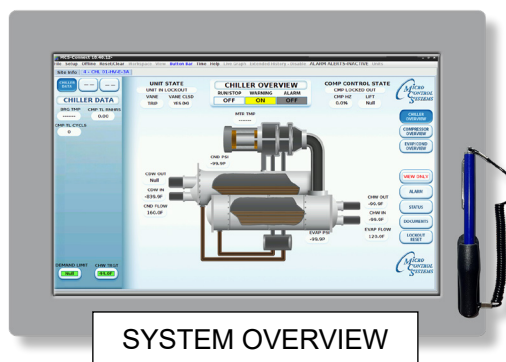

# Example Typical Upgrade with Optional Boards

## MCS-NitroMag-N

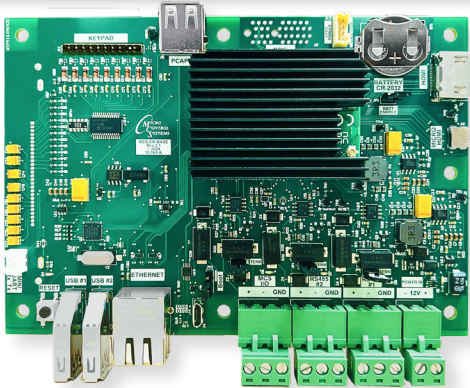


The **MCS-NitroMag-N** is a control system containing a processor, memory, eMMC Flash, and supporting power circuitry. The Broadcom quad-core processor delivers a blazing speed of 1.5GHz.

The MCS-NitroMag-N controller connects with MCS Expansion boards and Extension boards, allowing for a maximum of 144 SI inputs, 90 RO outputs, and 36 AO outputs.

The MCS-NitroMag-N comes with a built-in WiFi interface for Ethernet connectivity, and an onboard WiFi antenna connection.


## MCS-IO-BASE & MCS-IO-EXT

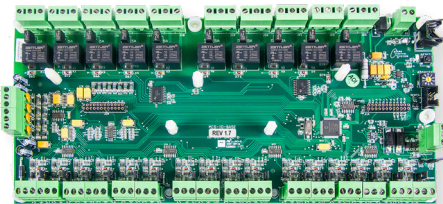

MCS-IO-BASE has a stand-alone microprocessor which communicates with a MCS-NitroMag, over the MCS-I/O port at 38,400 baud.

All data is check summed with auto error correction. Because communication is over a RS-485 long distance two-wire differential network transmission system, the MCS-IO-BASE may be located up to 5,000 feet away.


Each MCS-IO-BASE board can be powered by a 12VDC regulated power supply and has a automatic power fail reset system.

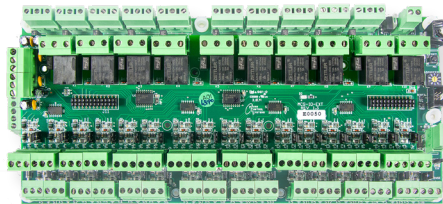

The **MCS-IO-EXT** provides a flexible and cost effective way to allow relay output, sensor input and analog output expansion for the MCS-NitroMag, MCS-MAGNUM / Micromag.

Each MCS-IO-EXT can be paired with a MCS-IO-BASE to double the number of inputs and outputs. Each MCS-IO-EXT board is powered by the MCS-IO-BASE board once it is stacked on top.


## MCS-SI-BASE & MCS-SI-EXT

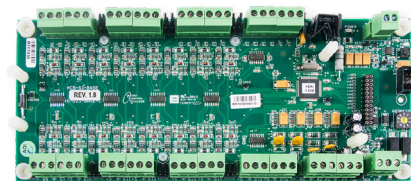

The **MCS-SI-BASE** provides a flexible and cost effective way to allow sensor input and analog output expansion for the MCS-NitroMag over the MCS-I/O port at 38,400 baud. Each MCS-SI-BASE has a stand-alone microprocessor which communicates over the MCS-I/O port at 38,400 baud.

All data is check summed with auto error correction. Because communication is over a RS-485 long distance two-wire differential network transmission system, the MCS-SI-BASE may be located up to 5,000 feet away.

Each MCS-SI-BASE board is powered by a 12VDC regulated power supply and has a automatic power fail reset system.

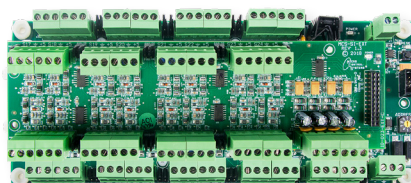


The **MCS-SI-EXT** provides a flexible and cost effective way to allow sensor input and analog output expansion for the MCS-NitroMag.

Each MCS-SI-EXT can be paired with a MCS-SI-BASE to double the number of inputs and outputs.

Each MCS-SI-EXT board is powered by the MCS-SI-BASE board once it is stacked on top.

# Example Typical Control Upgrade

## MCS-RO-Base & MCS-RO-EXT

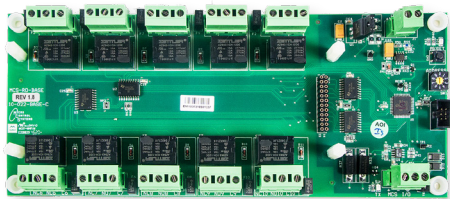


The **MCS-RO-BASE** provides a flexible and cost effective way to allow relay output expansion for the MCS-NitroMag.

Each MCS-RO-BASE has a stand-alone microprocessor which communicates over the MCS-I/O port at 38,400 baud.

All data is check summed with auto error correction. Because the communication is over a RS-485 long distance two-wire differential network transmission system, the MCS-RO-BASE may be located up to 5,000 feet away.

The MCS-RO-BASE board is powered by a 12VDC regulated power supply.

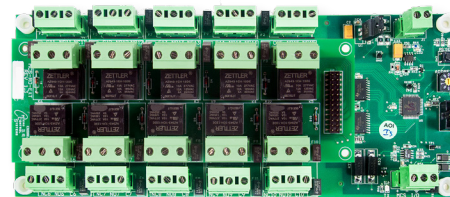

The **MCS-RO-EXT** provides a flexible and cost effective way to allow relay output expansion for the MCS-NitroMag.

The MCS-RO-EXT can be paired with a MCS-RO-BASE to double the number of outputs.

Each MCS-RO-EXT board is powered by the MCS-RO-BASE board once it is stacked on top.

## MCS-PRESSURE TRANSDUCERS

The **MCS Pressure Transducers** are one of the most economical and durable options on the market for dealing with high-pressure industrial applications.

In addition to being CE and UL approved, MCS transducers are capable of surviving high vibration. They include a cavity built out of solid 17-4 PH stainless steel 1/4" SAE Female Flare fitting & Schrader valve; 7/16-20 UNF pipe thread which creates a leak-proof, all metal sealed system that makes the transducers ideal for use with rugged HVAC environments.



## MCS-Wells/Tubes

The MCS-WELL was designed to be used with the MCS-T100 temperature sensor, although it has other applications. It is used in the CVHE-F series chillers in the chilled water and condenser water lines. It comes pre-filled with heat conductive compound to aid in transferring temperature to the sensor.



1/4- 2.5"



The **MCS-TUBE** can be epoxied to a discharge or suction line on the CVHE-F series chillers in order to obtain temperature readings without the use of a well. It was designed to be used with the MCS-T100 temperature sensor and comes pre-filled with heat conductive compound to aid in transferring temperature to the sensor.

# Example Typical Control Upgrade

## MCS-T100 Temp Sensor



An extremely fast acting temperature sensor built for demanding environments. It is ideal for high moisture locations with continuous freeze and thaw cycles. The sensor is potted with a thermally conductive RTV Cure Silicon Adhesive to guarantee durability and response. Its high accuracy allows for interchangeability in the field. The large resistance range allows the use of over 1,000' of cable with no noticeable effect. The MCS-T100 sensor has the ability to move from 32°F to 212°F in approximately 10 to 15 seconds.

## MCS-EPOXY

- Pre-measured resins and hardeners in one tube
- Easy to use - bonds, seals, plugs, molds and rebuilds
- No special tools needed
- Cures under water



- Pressure tested to ..... 1300 psi
- Temperatures up to ..... 500 degree F
- Color..... Gray
- Density ..... 15.9 lb/gal (1.9 g/cc)
- Hardness (Shore D) ..... 85
- Tensile Strength ..... 6000 psi
- Compressive Strength ..... 18.000 psi
- Modulus of Elasticity ..... 6 x 105 psi
- Shear Strength ..... 700 psi

## MCS-USB-RS485



The **MCS-USB-RS485** is a USB to RS485 cable that provides a fast simple way to connect a **MCS-MAGNUM** to a Laptop or PC.

The MCS-USB-RS485 cable contains a small internal electronic circuit board, which converts USB to RS485 with LED indicators for transmit (TX=Red) and receive (RX=Green).

## MCS-CARRIER 5K-ADAPTER

The 19X series chillers comes equipped with embedded 5K thermistors in the motor. There are two (2) thermistors factory installed in each compressor. There are three (3) terminals for the thermistors. (S1, S2 & C) Motor temperature is measured by leads connected to one of the S terminals and the C terminal.

The thermistor's are not field serviceable. If both motor thermistors fail the compressor needs to be replaced.

In order to monitor the motor on the 19X series chillers a cable is installed on the C and S1 terminals of the Carrier's thermistor and then wired along with the MCS-CARRIER 5K-ADAPTER to a sensor input on the MCS-MAGNUM or MCS-SI-BASE board. This allows the MAGNUM to monitor the temperature of the 19X series motors for proper operation.

A wiring diagram and instructions are included with the MCS-CARRIER 5K-ADAPTER.



# Example Typical Control Upgrade

## MCS-CT500



The **MCS-CT500** current sensor monitors current flowing to electrical equipment. The magnitude of the current is converted to a linear output voltage between 0.06 to 4.52vdc which can be read as a standard analog input signal. The signal is used by MCS micro controllers for the following:


1. For slide valve control on screw machines
2. For high amp motor overload protection
3. For verification of device on / off

## MCS-VOLTAGE-3PH

The **MCS-VOLTAGE-3PH** measures AC voltage between 200-600 AC. It is designed to monitor the voltage of each phase of the main input power to the unit.

The MCS-VOLTAGE-3PH sensor provides three separate DC voltage outputs that correspond to the AC voltage it is measuring.

This sensor allows the **MCS-Magnum** to safely protect the motors on the unit from under voltage, over voltage and voltage imbalance conditions. It also can be used to calculate unit KW (requires amp and power factor sensors).

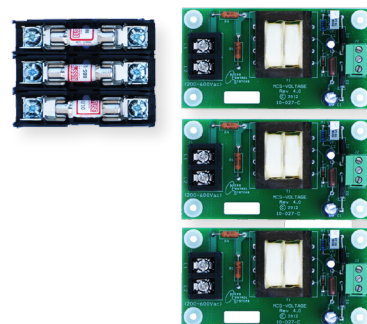

## 19XL / XR Typical Option

### MCS-EXV-DRIVER



The **MCS-EXV-DRIVER** is used for the positioning and control of Sporlan, Alco, Carel, and Danfoss bipolar expansion valves using an analog input of 0-10 VDC (0 VDC = 0% valve opening, 10 VDC = 100% valve opening). The MCS-EXV-DRIVER also supports overdriving on full opened and full closed voltage signals. The display decimal notifies when overdriving by blinking.

**Auto Mode** – The unit defaults to this mode after every power up. In this mode, the MCS-EXV-DRIVER-XX positions the valve according to the analog input control voltage. **Manual Mode** – When in auto mode, if holding the 'Auto/Manual' key for 5 seconds and then entering the authorization number switches the unit into manual mode.

# Example Typical Points List

## Relay Outputs (MCS-IO-BASE)

#	Output Name	Type	Description
1-1	CompM	Standard	Compressor Start Main
1-2	CompD	Standard	Compressor Start Delta
1-3	OpenVane	Standard	Vane open: relay output used to open the compressor guide vane.
1-4	CloseVane	Standard	Vane closed: relay output used to close the compressor guide vane.
1-5	OilPump	Standard	Oil pump: Turn ON or OFF
1-6	OilHeater	Standard	Oil heater: Turn ON or OFF
1-7	HtrLock	User Logic	Heater Lock (Lock is ON when Compressor is ON)
1-8	Spare	X	Not Used - Reserved for Expansion
1-9	Spare	X	Not Used - Reserved for Expansion
1-10	Spare	X	Not Used - Reserved for Expansion

## Relay Outputs (MCS-IO-EXT)

2-1	Spare	X	Not Used - Reserved for Expansion
2-2	Warning	Standard	Warning Light: unit is in a safety condition prior to a safety shutdown.
2-3	Alarm	Standard	Alarm Light: unit is in a safety shutdown
2-4	RunStatus	User Logic	Hardwired or BMS point to notify BMS that the unit is running
2-5	Spare	X	Not Used - Reserved for Expansion
2-6	Spare	X	Not Used - Reserved for Expansion
2-7	Spare	X	Not Used - Reserved for Expansion
2-8	ChwPump	Standard	Chilled Water Pump: Turn ON or OFF
2-9	CondPump	Standard	Condenser Pump: Turn ON or OFF
2-10	Spare	X	Not Used - Reserved for Expansion

## Relays Outputs (virtual board)

3-1	Spare	X	Not Used - Reserved for Expansion
3-2	Spare	X	Not Used - Reserved for Expansion
3-3	MtrCooling	User Logic	Motor Cooling: Turn ON or OFF
3-4	Spare	X	Not Used - Reserved for Expansion
3-5	Spare	X	Not Used - Reserved for Expansion
3-6	Spare	X	Not Used - Reserved for Expansion
3-7	Spare	X	Not Used - Reserved for Expansion

# Example Typical Points List

## Relays Outputs (virtual board continued)

#	Output Name	Type	Description
3-8	Spare	X	Not Used - Reserved for Expansion
3-9	Spare	X	Not Used - Reserved for Expansion
3-10	Spare	X	Not Used - Reserved for Expansion
Relays Outputs (virtual board)			
4-1	Spare	X	Not Used - Reserved for Expansion
4-2	Spare	X	Not Used - Reserved for Expansion
4-3	HwBmsR/S	User Logic	Hardwired BMS Run/Stop
4-4	NtBmsR/S	User Logic	Virtual Network Point for BMS Run/Stop
4-5	Spare	X	Not Used - Reserved for Expansion
4-6	Spare	X	Not Used - Reserved for Expansion
4-7	Spare	X	Not Used - Reserved for Expansion
4-8	DisHWRst	User Logic	Disallow Hardwire Reset
4-9	DisNetRst	User Logic	DisNetRst
4-10	HtrlLock	User Logic	Heater Lock (Lock is ON when Compressor is ON)

## Sensor Inputs MCS-IO-BASE)

#	Input Name	Type	Description
1-1	ChilWtrIn	MCST100	Chilled Water In Temperature
1-2	ChilWtrOut	MCST100	Chilled Water Leaving Temperature
1-3	Suct Psi	MCS--200	Suction Pressure
1-4	DiscPsi	MCS-500	Discharge Pressure
1-5	OilFeedPsi	MCS-500	Oil Supply Pressure
1-6	OilSumpPsi	CARR-5K	Oil Sump Pressure
1-7	SuctTmp	MCST100	Suction Temperature
1-8	DiscTmp	MCST100	Discharge Temperature
1-9	OilFeedTmp	MCST100	Oil Supply Temperature
1-10	Spare	X	Not Used - Reserved for Expansion
1-11	OilSumpTmp	CARR-5K	Oil Sump Temperature
1-12	Spare	X	Not Used - Reserved for Expansion
1-13	VaneClosed	Digital	Vane Closed Switch: ON or OFF
1-14	PhaseLoss	Digiital	Phase Loss: Phase Imbalance

# Example Typical Points List

## Sensor Inputs MCS-IO-BASE continued)

#	Input Name	Type	Description
1-15	Run/Stop	Digital	Run/Stop Hand Switch
1-16	EmgStop	Digital	Emergency Stop Switch

## Sensor Inputs (MCS-IO-EXT)

2-1	CndRefTmp	MCST100	Condenser Refrigerant Temperature
2-2	EvapRefTmp	MCST100	Evaporator Refrigerant Temperature
2-3	CmpAmps A	CT-1500	Reads Amp Draw on Leg 1
2-4	CmpAmps B	CT-1500	Reads Amp Draw on Leg 2
2-5	CmpAmps C	CT-1500	Reads Amp Draw on Leg 3
2-6	Volts A	User Defined	Volts Phase A
2-7	Volts B	User Defined	Volts Phase B
2-8	Volts C	User Defined	Volts Phase C
2-9	HiPsiSW	Digital	Mechanical Hi Pressure Safety
2-10	MotorTmp	CARR-5K	Motor Temperature
2-11	Spare	X	Not Used - Reserved for Expansion
2-12	Spare	X	Not Used - Reserved for Expansion
2-13	BearingTmp	CARR-5K	Bearing Temperature
2-14	Spare	X	Not Used - Reserved for Expansion
2-15	TransOK	Digital	Transition Starter OK
2-16	Spare	X	Not Used - Reserved for Expansion

## Sensor Inputs (MCS-SI-BASE)

3-1	Spare	X	Not Used - Reserved for Expansion
3-2	Spare	X	Not Used - Reserved for Expansion
3-3	Spare	X	Not Used - Reserved for Expansion
3-4	Spare	X	Not Used - Reserved for Expansion
3-5	Spare	X	Not Used - Reserved for Expansion
3-6	Spare	X	Not Used - Reserved for Expansion
3-7	ChwFlowSW	Digital	Proof for Chilled Water Flow
3-8	CdwFlowSW	Digital	Proof for Condenser Water Flow
3-9	OilDiffSW	Digital	Oil pressure differential
3-10	CndWtrIn	MCST100	Condenser Water Incoming Temperature
3-11	CndWtrOut	MCST100	Condenser Water Leaving Temperature

# Example Typical Points List

## Sensor Inputs (MCS-SI-BASE continued)

#	Input Name	Type	Description
3-12	Spare	X	Not Used - Reserved for Expansion
3-13	HwBmsDmd	DEMAND%	Hardwired Point for Demand %
3-14	HwBmsChwr	TRGTRST	Hardwired BMS Chilled Water Reset: Reset Target Temperature
3-15	Spare	X	Not Used - Reserved for Expansion
3-16	Spare	X	Not Used - Reserved for Expansion

## Sensor Inputs (virtual board)

4-1	Spare	X	Not Used - Reserved for Expansion
4-2	Spare	X	Not Used - Reserved for Expansion
4-3	Spare	X	Not Used - Reserved for Expansion
4-4	Spare	X	Not Used - Reserved for Expansion
4-5	Spare	X	Not Used - Reserved for Expansion
4-6	Spare	X	Not Used - Reserved for Expansion
4-7	Spare	X	Not Used - Reserved for Expansion
4-8	Spare	X	Not Used - Reserved for Expansion
4-9	Spare	X	Not Used - Reserved for Expansion
4-10	Spare	X	Not Used - Reserved for Expansion
4-11	Spare	X	Not Used - Reserved for Expansion
4-12	UnitInL/O	User Logic	Tests for Unit in Lock Out
4-13	CtlRun/Stop	User Logic	Control Run/Stop
4-14	Spare	X	Not Used - Reserved for Expansion
4-15	Spare	X	Not Used - Reserved for Expansion
4-16	Spare	X	Not Used - Reserved for Expansion

## Sensor Inputs (virtual board)

5-1	Spare	X	Not Used - Reserved for Expansion
5-2	Spare	X	Not Used - Reserved for Expansion
5-3	ChwGPM	User Logic	Chilled Water Gallons per Minute. Fixed value or true hardwired input.
5-4	Spare	X	Not Used - Reserved for Expansion
5-5	NetBmsRun	BMS-SI	Virtual Network Point for Run/Stop
5-6	NetBmsDmd	BMS-SI	Virtual Network Point for Demand %
5-7	NetBmsCwr	BMS-SI	Virtual Network Point for Chilled Water Reset: Reset Target Temp
5-8	Fla%	User Logic	Full Load Amp %

# Example Typical Points List

## Sensor Inputs (virtual board continued)

#	Input Name	Type	Description
5-9	Lift	User Logic	Lift Calculation
5-10	ChwAppr	User Logic	Condenser Water Approach: Difference between saturated discharge temperature minus the condenser leaving water temperature
5-11	ChwDiffTmp	User Logic	Chilled Water Temperature Differential: Difference between entering/leaving temperature
5-12	CdwAppr	User Logic	Condenser Water Approach: Difference between saturated discharge temperature minus the condenser leaving water temperature
5-13	CdwDiffTmp	User Logic	Chilled Water Temperature Differential: Difference between entering/leaving temperature
5-14	Spare	X	Not Used - Reserved for Expansion
5-15	Subcooling	User Logic	Subcooling Calculation
5-16	Spare	X	Not Used - Reserved for Expansion

## Sensor Inputs (MCS-SI-EXT)

6-1	Spare	X	Not Used - Reserved for Expansion
6-2	Spare	X	Not Used - Reserved for Expansion
6-3	Spare	X	Not Used - Reserved for Expansion
6-4	Unit Tons	TONS	Measures Unit Tons
6-5	Unit KW	KW	Measures Unit KW
6-6	Kw/Tons	User Logic	KW / Ton Calculation
6-7	PwrFactor	User Logic	Power Factor Calculation
6-8	Spare	X	Not Used - Reserved for Expansion
6-9	OilPsiSwOK	User Logic	Proof of Oil Pressure Switch OK
6-10	Spare	X	Not Used - Reserved for Expansion
6-11	Spare	X	Not Used - Reserved for Expansion
6-12	Ctl Flow	User Logic	Control Flow - Tests both Condenser and Chilled Water Flow
6-13	Spare	X	Not Used - Reserved for Expansion
6-14	Spare	X	Not Used - Reserved for Expansion
6-15	Spare	X	Not Used - Reserved for Expansion
6-16	Spare	X	Not Used - Reserved for Expansion

## Sensor Inputs (virtual board)

7-1	Spare	X	Not Used - Reserved for Expansion
7-2	Spare	X	Not Used - Reserved for Expansion

# Example Typical Points List

## Sensor Inputs (virtual board continued)

7-3	Spare	X	Not Used - Reserved for Expansion
7-4	Spare	X	Not Used - Reserved for Expansion
7-5	Spare	X	Not Used - Reserved for Expansion
7-6	HwBmsDMD	User Logic	Hardwired Point for Demand %
7-7	HwBmsRset	User Logic	Hardwired Point for Target Reset
7-8	NtBmsDMD	User Logic	Virtual Network Point for Demand %
7-9	NtBmsRset	User Logic	Virtual Network Point for Target Reset
7-10	BMS R/S	User Logic	Virtual Network Point for Run/Stop
7-11	BMS DMD	User Logic	Virtual Network Point for Demand %
7-12	BMS Reset	User Logic	Virtual Network Point for Target Reset
7-13	d/aHwRst	User Logic	Disallow Hardwired Reset
7-14	d/aNetRst	User Logic	Disallow Network Reset
7-15	Spare	X	Not Used - Reserved for Expansion
7-16	Allow Unit	User Logic	Run/stop indicator for graphic display

# Sample Questionnaire

Visit <https://www.mcscontrols.com/brochures.html> for a fillable form to email to [sales@mcscontrols.com](mailto:sales@mcscontrols.com)

## General Information

Company: \_\_\_\_\_ Phone: \_\_\_\_\_

Name: \_\_\_\_\_ Title: \_\_\_\_\_ Email: \_\_\_\_\_

Mobile: \_\_\_\_\_ Site: \_\_\_\_\_

## Unit Information

Installation Site Name \_\_\_\_\_

Model # \_\_\_\_\_ Unit Serial # \_\_\_\_\_ Site Unit # \_\_\_\_\_

What is the Voltage of the Unit? ☐ 208V, ☐ 230V, ☐ 460V, ☐ 4160V, Other Voltage \_\_\_\_\_

What is the Control voltage in the unit? ☐ 24V, ☐ 115V, ☐ 230V, What type of Refrigerant is being used? \_\_\_\_\_

Is MCS monitoring Main Voltage? ☐ Yes ☐ No. Will Phase loss need to be monitored? ☐ Yes ☐ No.

## Network Information

1. Integrating to Building Management System (BMS) ☐ Yes ☐ No, If yes, complete the form provided on page 2.

## Motor Information

2. What is the Starter Type? \_\_\_\_\_ Are we monitoring the transition OK or Start Fault? \_\_\_\_\_

a. Does the Compressor have a remote starter? ☐ Yes ☐ No.

3. Is there a Variable Frequency Drive? ☐ Yes ☐ No

a. What is the VFD Make and Model? VFD Make \_\_\_\_\_ VFD Model \_\_\_\_\_

b. Will the VFD be hardwired to MCS controls, or MODBUS \_\_\_\_\_

c. Is MCS required to control VFD Cabinet Auxiliary Fan? ☐ Yes ☐ No.

4. What are the Motor "RUN LOAD AMPS"(FLA)? COMP 1: \_\_\_\_\_ COMP 2: \_\_\_\_\_

5. Is Hot Gas Bypass present? ☐ Yes ☐ No, How does it operate? \_\_\_\_\_

## Purge Information

6. What is the Purge Type on the unit, how is it controlled? \_\_\_\_\_

## Evap/Condenser/Pump Information

7. Is MCS controlling the chiller Water Pump(s)? ☐ Yes ☐ No, How will they be wired? \_\_\_\_\_

8. Is MCS controlling the Condenser water Pump(s)? ☐ Yes ☐ No, How will they be wired? \_\_\_\_\_

9. Is MCS controlling Condenser/Evaporator Isolation Valve? ☐ Yes ☐ No ☐ BMS.

10. Is MCS controlling tower fan(s)? ☐ Yes ☐ No, How many are there \_\_\_\_\_, how are they wired? \_\_\_\_\_

11. Will the Chilled/Condenser Water Flow be measured by? \_\_\_\_\_

## Ambient Information

12. Will Ambient temperature need to be monitored? ☐ Yes ☐ No.

## CVHA Information Only

13. Is there a Motor Cooler? ☐ Yes ☐ No, Will MCS be monitoring the Oil Feed? ☐ Yes ☐ No, Return Temperature? ☐ Yes ☐ No

COMMENTS (Is there any other information we need to know?):

Click for Brochure Upgrades ►

1. **Viewing form printed Brochure.** Scan QR code from mobile device, email the form to your email address.
2. Click on the emailed link. Fill out the digital fillable form on a computer and email to [sales@mcscontrols.com](mailto:sales@mcscontrols.com)
3. **Viewing brochure from Computer,** click on QR code, find the form your need, click on fillable form, fill out and email to [sales@mcscontrols.com](mailto:sales@mcscontrols.com)





**5580 Enterprise Pkwy., Fort Myers, FL 33905**

**Office: 239-694-0089 • Fax: 239-694-0031**

**[www.mcscontrols.com](http://www.mcscontrols.com)**