




5580 Enterprise Pkwy., Fort Myers, FL 33905
Office: (239) 694-0089 Fax: (239) 694-0031

Total Solution for all your Control Needs



Old controls

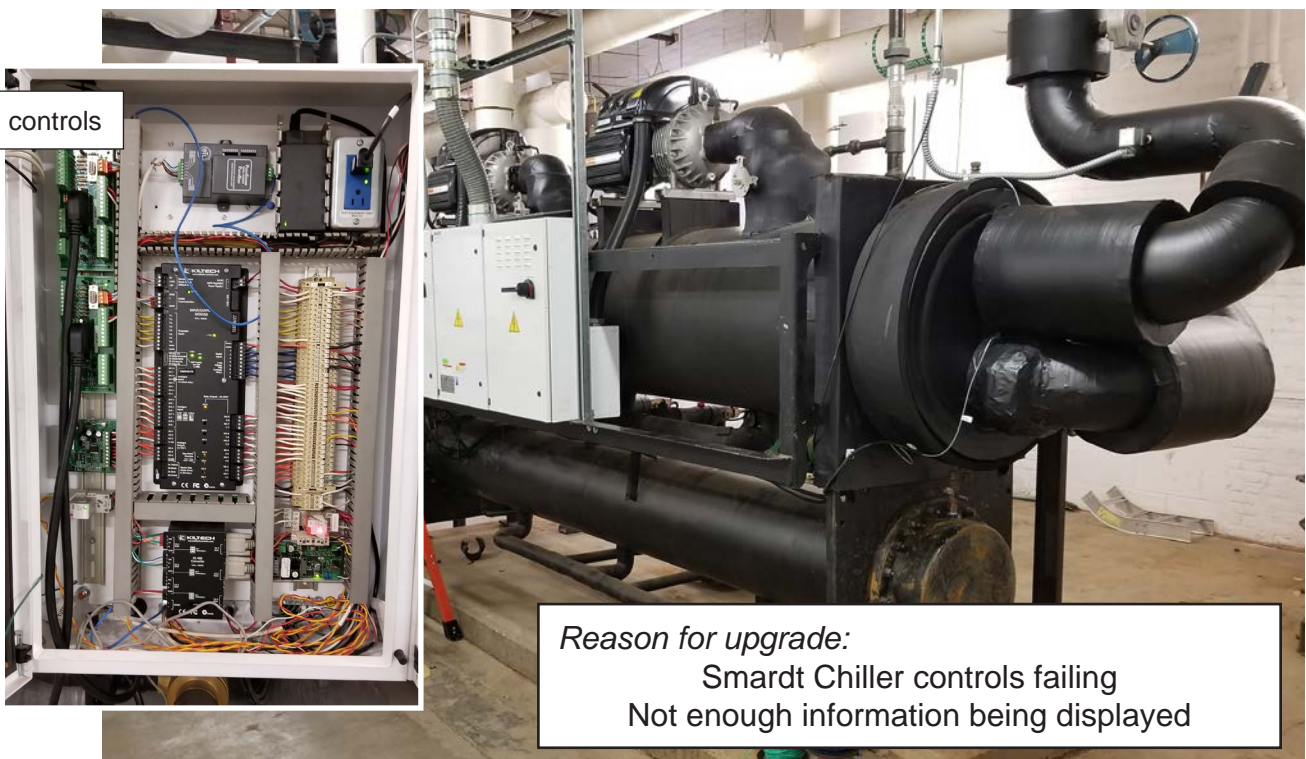

Reason for upgrade:
Smartt Chiller controls failing
Not enough information being displayed



Total Solution for all your Control Needs

General Electric Corporation

Site Location:

General Electric
Schenectady, NY

- Repair Center provides world class gas turbine servicing and repairs

Concerns:

- Old controls failed
- Wanted controls that were easier to understand and more reliable, plus displayed more information

Equipment:

- Smartt Water Cooled Chillers
- Two (2) Turbocor Compressors
- Two (2) Exv's controlling condenser level
- Load balancing EXV control
- Modulating condenser water valve

Steps Taken:

- Remove existing controls
- Install MCS controls
- Reprogram Turbocor boards for communication
- Provide on-site training and support for contractor to better understand MCS controls.

Results:

One Smartt Turbocor Chiller upgraded with MCS controls and one satisfied customer who is very happy with all the information and data available compared to the competitor's controls.

CONTRACTOR:

