MCS-BMS-GATEWAY

MCS-BMS-GATEWAY to MCS-MAGNUM

Mounting & Wiring Diagram

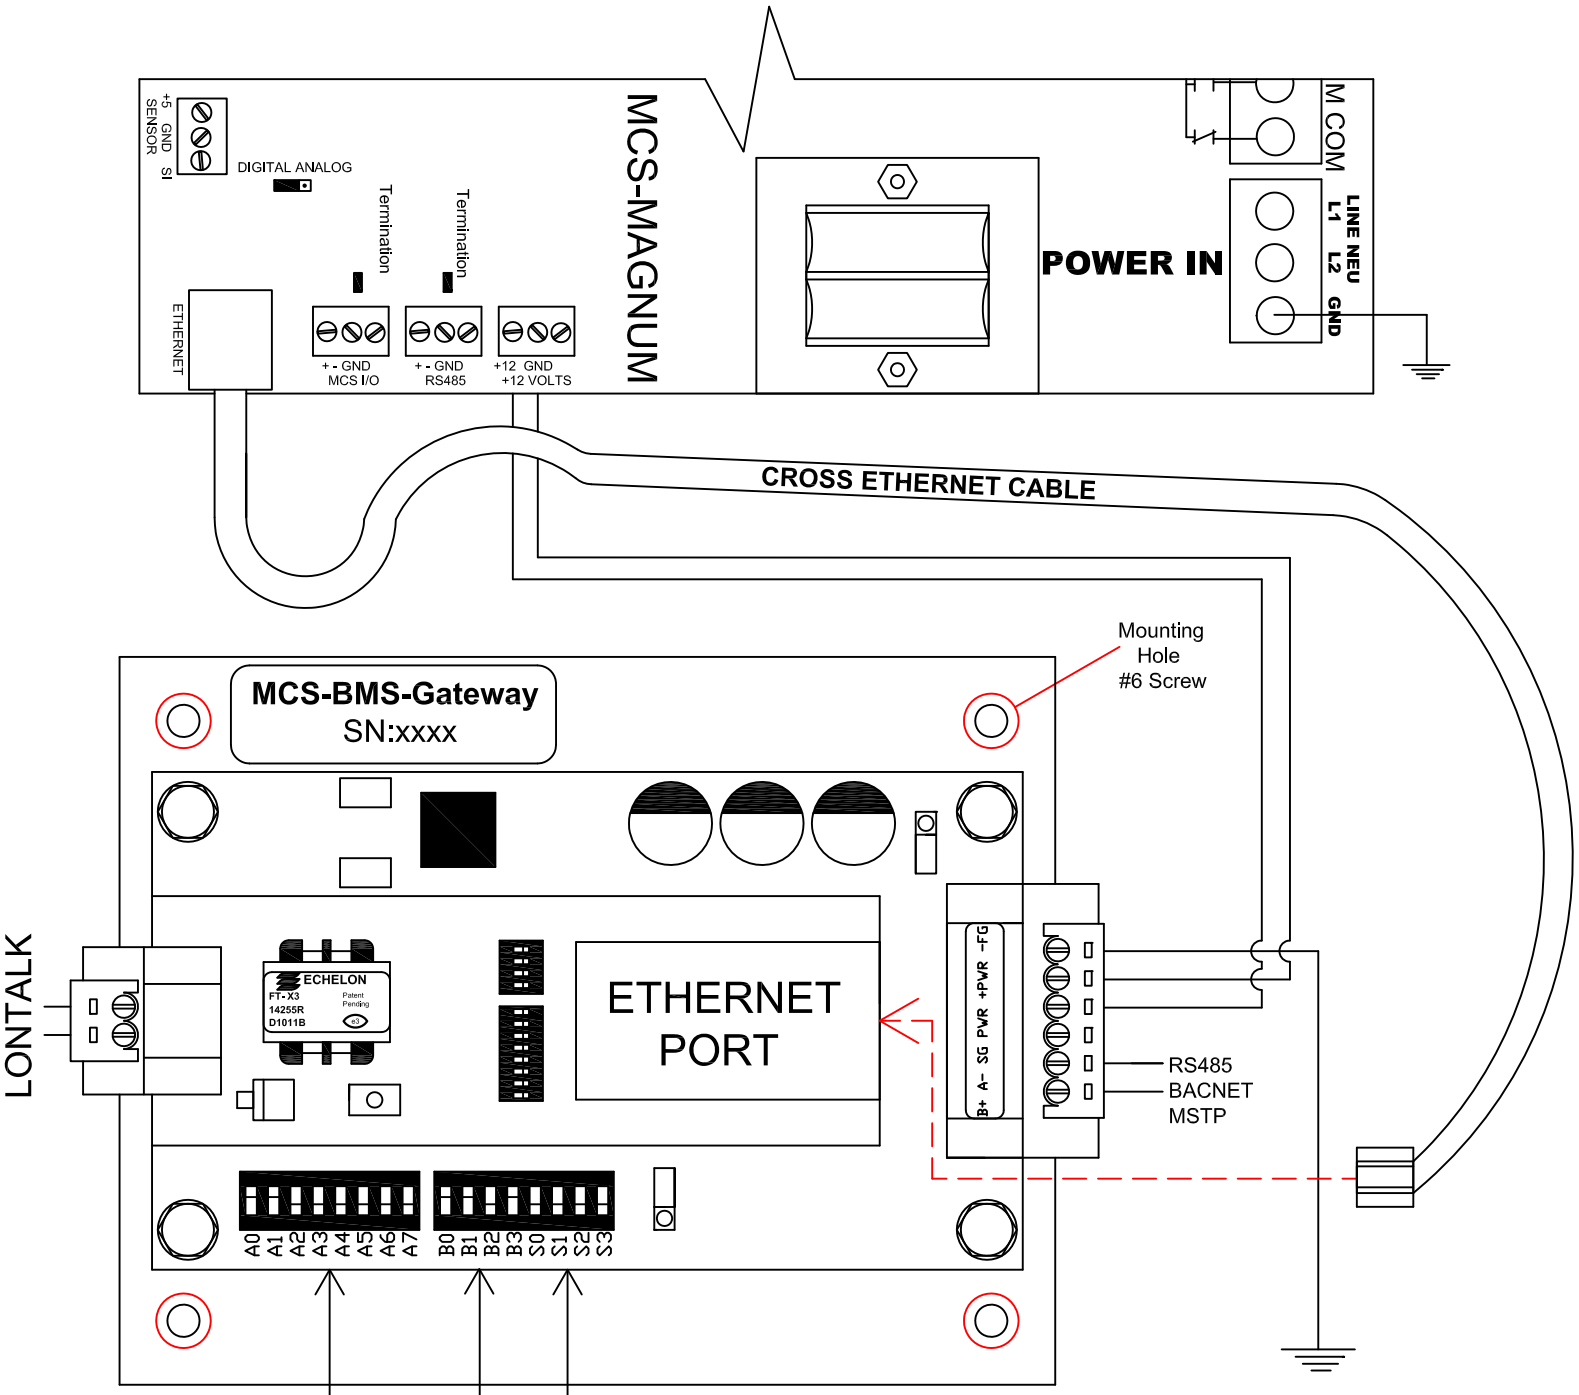

BMS 485 Address (Bacnet MSTP) See Documentation for Details.

Addressing Values	
A0	1
A1	2
A2	4
A3	8
A4	16
A5	32
A6	64
A7	128

The values of the switches in the on position are added together to determine the module's address.

MCS-BMS-Gateway	MCS-BMS-Gateway DIP Switches			
Profile - MCS-BMS-Gateway	**S0**	**S1**	**S2**	**S3**
LonWorks	Off	Off	Off	Off
Bacnet MS/TP	On	Off	Off	Off
Johnson N2	Off	On	Off	Off

Baud	B0	B1	B2	B3
Auto	Off	Off	Off	Off
9600	On	On	On	Off
19200	Off	Off	Off	On
38400	On	On	Off	On
76800	On	Off	On	On
115200	Off	On	On	On

5580 Enterprise Pkwy, Fort Myers, FL 33905 USA
Phone: (239) 694 0089 - Fax: (239) 694 0031
www.mcscontrols.com - support@mcscontrols.com

MICRO CONTROL SYSTEMS