



SOFTWARE RELEASE NOTES

MCS-CONFIG

Version 8.00I


03/04/2011

Updates from previous versions:

New Features:

1. A 3 position Mode Select Switch (MODE SEL SW) sensor type has been added to CENT software configurations for use with Trane purge control logic.

Typical Sensor Wiring:

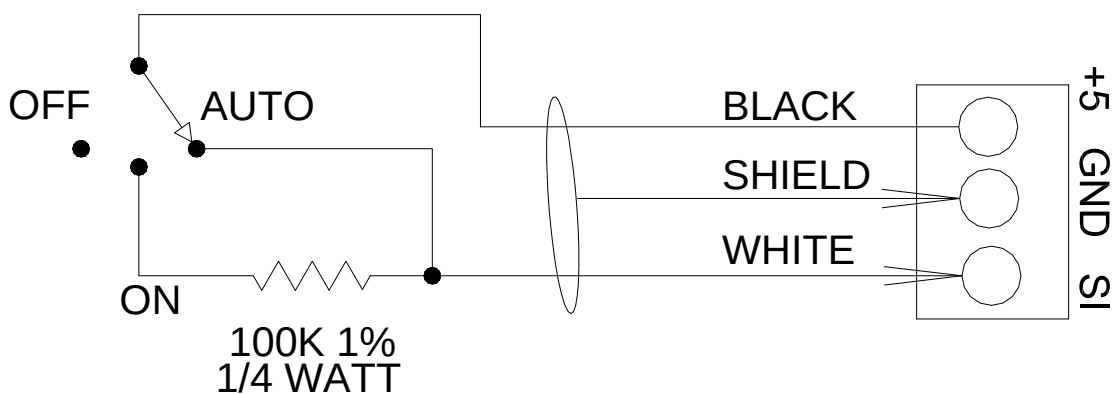

Switch Position	Voltage at SI
OFF	0vdc
ON	2.5vdc
AUTO	5.0vdc

Conversion Logic in Magnum Software

If Sensor Input voltage is less than 1.5vdc, then the mode is OFF.

If Sensor Input voltage is less than 3.5vdc, then the mode is ON.

If Sensor Input voltage is between 3.5vdc and 5.0vdc, then the mode is AUTO.

Any questions regarding this release, contact:

support@mcscontrols.com

Micro Control Systems, Inc. 5580 Enterprise Parkway Fort Myers, Florida 33905
(239)694-0089 FAX: (239)694-0031 www.mcscontrols.com

Information contained in this document has been prepared by Micro Control Systems, Inc. and is copyright © protected 2012. Copying or distributing this document is prohibited unless expressly approved by MCS.